

12/8/2023 9:03 AM
 s:\projects\euro-wall systems\fb-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwgs\122410\ews031.dwg

EURO-WALL, LLC

EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)(NON-IMPACT)



EURO-WALL, LLC
 P.O. BOX 8007
 NORTH PORT, FL 34290
 PH: 888-989-3876

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 202-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: *EXTRUDED ALUMINUM (6063-T5)*.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.
- DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM COMPONENTS SHALL BE PROTECTED IN ACCORDANCE WITH THE FBC.

NOTE: WHEN INSTALLED AT A LOCATION PROTECTED BY AN OVERHANG SUCH THAT:
 OVERHANG (OH) RATIO = OH LENGTH ÷ OH HEIGHT IS ≥ 1.0 ,
 WATER INFILTRATION REQUIREMENT DOES NOT NEED TO BE MET



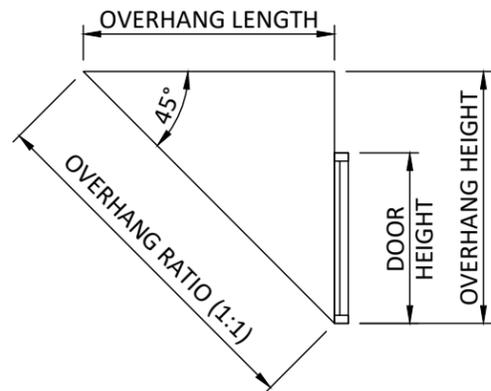


TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAILS
2	ELEVATION & ANCHOR LAYOUT
3	DESIGN PRESSURE TABLE
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	INSTALLATION NOTES, ANCHOR TABLE, & ANCHOR DETAILS
7	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE RATING			
MAX. UNIT DIMENSIONS	DESIGN PRESSURE	MISSILE IMPACT RATING	WATER TEST PRESSURE
SEE SHEET 3	SEE SHEET 3	NON-IMPACT	9 PSF

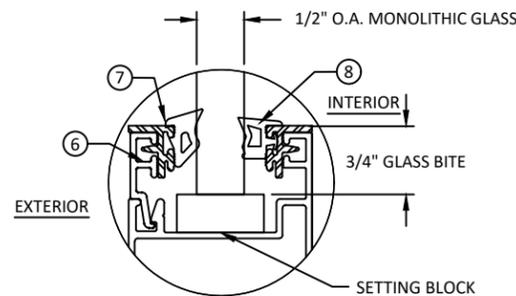

GLAZING DETAIL 1

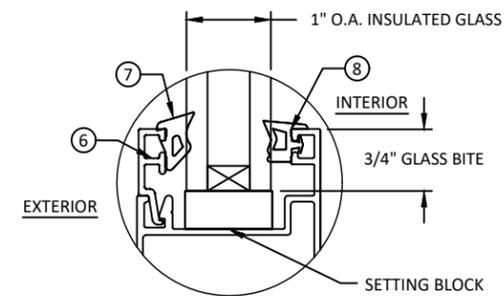

GLAZING DETAIL 2

- GLAZING NOTES:**
- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - GLASS TYPE SHALL COMPLY WITH APPLICABLE GLAZING REQUIREMENTS PER CHAPTER 24 OF THE FBC


TITLE: EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)(NON-IMPACT)
 GENERAL NOTES & GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
 1900 NE MIAMI COURT, STE. 2-15
 MIAMI, FL 33132
 PH: (954) 399-8478
 FAX: (954) 474-4738
 WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

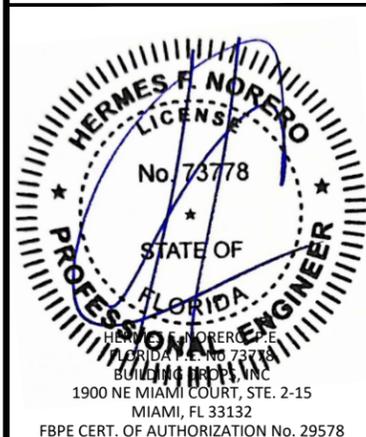

FL #:
FL22410

DATE: **04.26.23**

DWG. BY: **SH** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **EWS031**

SHEET:

1

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwg\122410\ews031.dwg

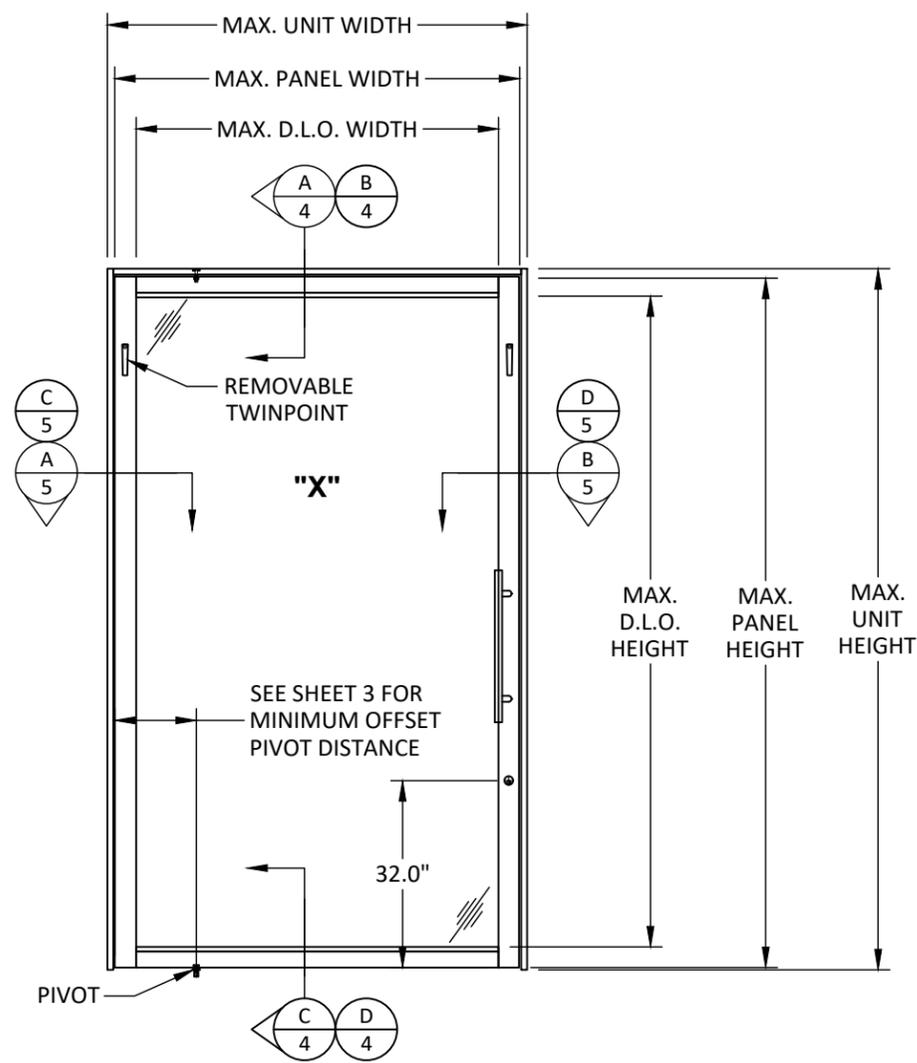


TYPICAL ELEVATION
PIVOT DOOR

SIZE NOTES:

UNIT SIZES SHOWN IN TABLE.

PANEL SIZES ARE AS FOLLOWS:
 PANEL WIDTH = UNIT WIDTH - 2.5625"
 PANEL HEIGHT = UNIT HEIGHT - 1.75"

D.L.O. SIZES ARE AS FOLLOWS:
 D.L.O. WIDTH = UNIT WIDTH - 9.75"
 D.L.O. HEIGHT = UNIT HEIGHT - 8.84"

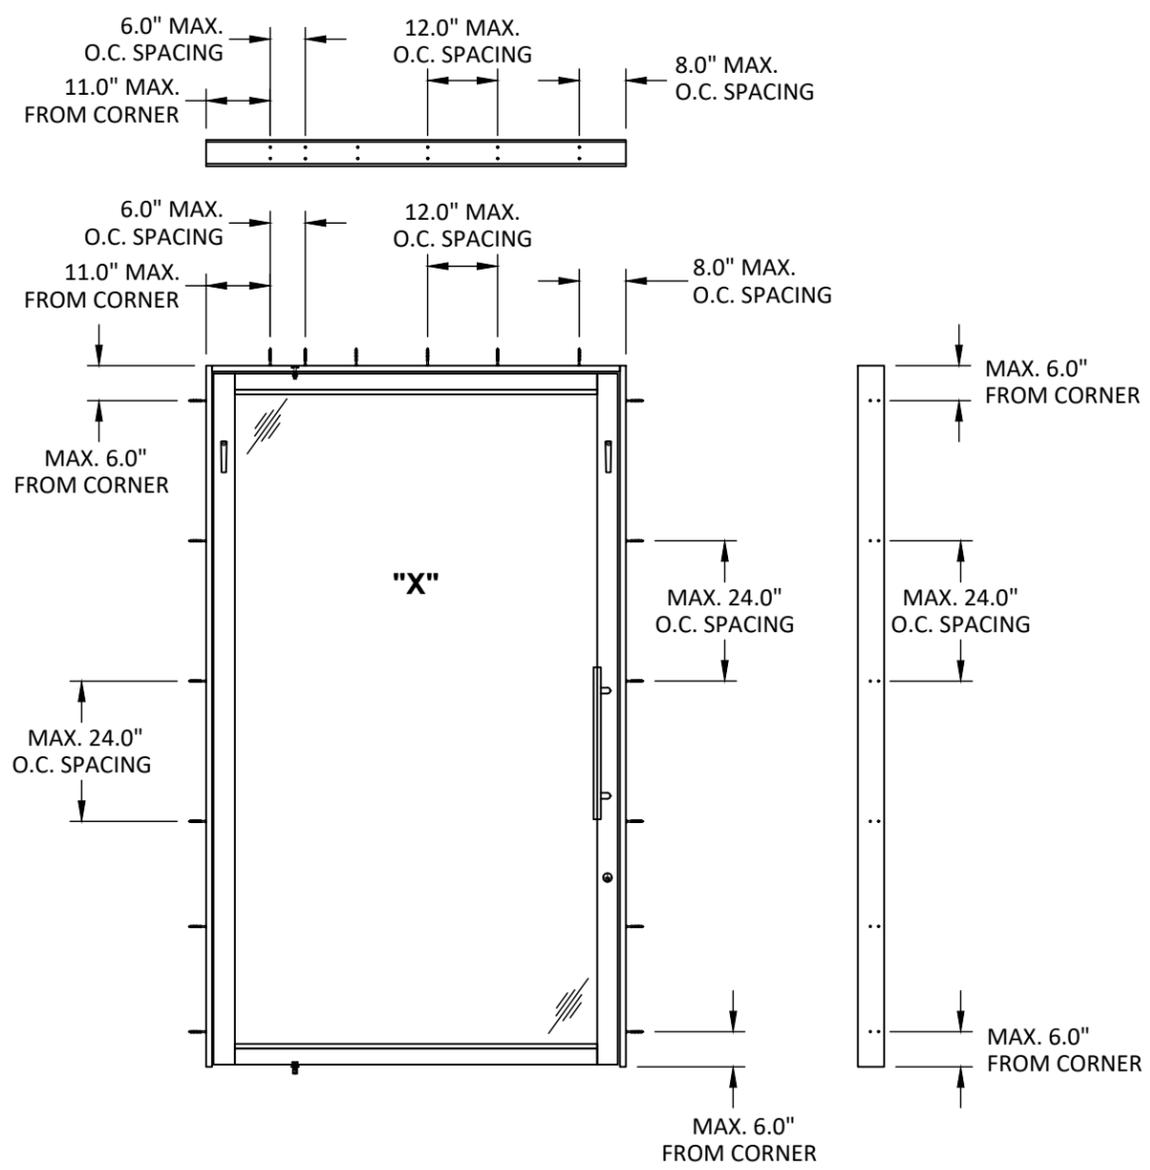

ANCHOR LAYOUT
PIVOT DOOR

NOTE:
 TWIN-POINT & MULTI-POINT LOCKING MECHANISM
 INTERCHANGEABLE BETWEEN ALL SIZES AND DESIGN
 PRESSURES.


EURO-WALL, LLC
 P.O. BOX 8007
 NORTH PORT, FL 34290
 PH: 888-989-3876

TITLE: EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)(NON-IMPACT) ELEVATION AND ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
 1900 NE MIAMI COURT, STE. 2-15
 MIAMI, FL 33132
 PH: (954)399-8478
 FAX: (954)744-4738
 WEB: www.buildingdrops.com

REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

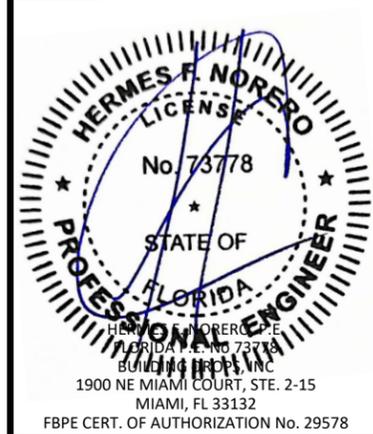

HERMES F. NORERO
 FLORIDA P.E. No. 73778
 BUILDING DROPS, INC.
 1900 NE MIAMI COURT, STE. 2-15
 MIAMI, FL 33132
 FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL22410**

DATE: **04.26.23**

DWG. BY: **SH** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **EWS031**

SHEET: **2**

s:\projects\euro-wall systems\fb-23-1121 - fbc submittal - non-impact aluminum products design table updates\dwgs\122410\ews031.dwg 12/8/2023 9:03 AM

ALLOWABLE DESIGN PRESSURE TABLE (+/- PSF)																						
UNIT HEIGHT (INCHES)	UNIT WIDTH (INCHES)																					
	60	64	68	72	76	80	84	88	92	96	100	104	108	112	116	120	124	128	132	136	140	144
96	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
102	60.0	60.0	60.0	60.0	56.8	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4	55.4
108	60.0	60.0	60.0	60.0	56.8	54.0	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4	51.4
114	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0	48.0
120	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
126	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	42.4	42.4	42.4	42.4	42.4	42.4	42.4	42.4	42.4	42.4	42.4
132	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0
138	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.9	37.9	37.9	37.9	37.9	37.9	37.9	37.9
144	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	36.0	36.0	36.0	36.0	36.0	36.0
150	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	34.3	34.3	34.3	34.3	34.3
156	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	32.7	32.7	32.7
162	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	31.3	31.3
168	60.0	60.0	60.0	60.0	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
174	60.0	60.0	60.0	59.2	56.8	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
180	60.0	60.0	60.0	58.5	56.4	54.0	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
186	60.0	60.0	60.0	57.9	55.7	53.8	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
192	60.0	60.0	59.7	57.3	55.1	53.2	51.4	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
198	60.0	60.0	59.2	56.7	54.5	52.6	50.8	49.1	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
204	60.0	60.0	58.7	56.3	54.0	52.1	50.3	48.7	47.0	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0
210	60.0	60.0	58.3	55.8	53.6	51.6	49.8	48.2	46.8	45.0	43.2	41.5	40.0	38.6	37.2	36.0	34.8	33.8	32.7	31.8	30.9	30.0

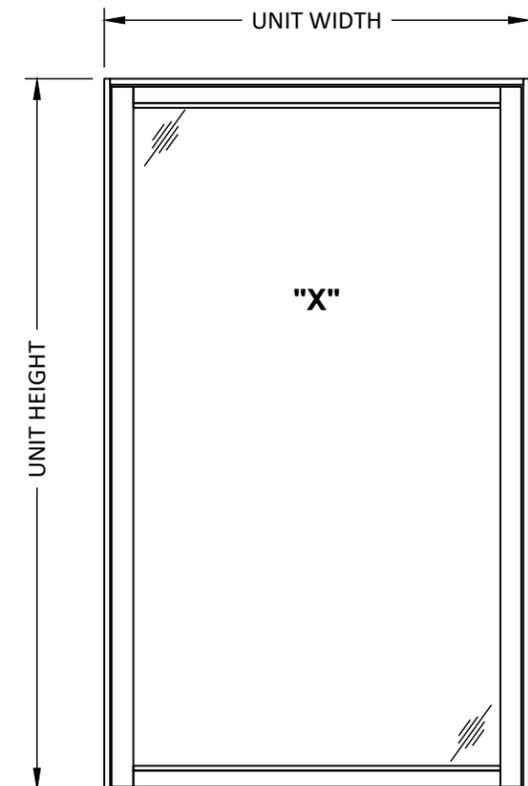


UNIT WIDTH (INCHES)																									
44	48	52	56	60	64	68	72	76	80	84	88	92	96	100	104	108	112	116	120	124	128	132	136	140	144
MINIMUM PIVOT OFFSET FROM JAMB (INCHES)																									
7	7	7	7	7	7	8	11	14	18	21	24	26	29	32	35	38	41	44	47	50	53	56	59	62	65

- INSWING AND OUTSWING UNITS WITH DRAINAGE SYSTEM RATED FOR 9 PSF WATER INFILTRATION RESISTANCE (CORRESPONDING TO 60 PSF DESIGN PRESSURE). UNITS WITHOUT DRAINAGE SYSTEM ARE NOT RATED FOR WATER INFILTRATION RESISTANCE.
- DP TABLE VALUES APPLICABLE TO INSWING AND OUTSWING UNITS.

MINIMUM PIVOT OFFSET FROM JAMBS



APPROVED PIVOT LOCATED AT CENTER

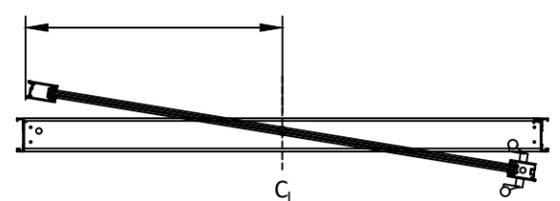

SIZE NOTES:

UNIT SIZES SHOWN IN TABLE.

PANEL SIZES ARE AS FOLLOWS:
 PANEL WIDTH = UNIT WIDTH - 2.00"
 PANEL HEIGHT = UNIT HEIGHT - 1.375"

D.L.O. SIZES ARE AS FOLLOWS:
 D.L.O. WIDTH = UNIT WIDTH - 9.822"
 D.L.O. HEIGHT = UNIT HEIGHT - 8.034"




EURO-WALL, LLC
 P.O. BOX 8007
 NORTH PORT, FL 34290
 PH: 888-989-3876

TITLE: EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)(NON-IMPACT) DESIGN PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC.
 1900 NE MIAMI COURT, STE. 2-15
 MIAMI, FL 33132
 PH: (954)399-8478
 FAX: (954)744-4738
 WEB: www.buildingdrops.com

REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

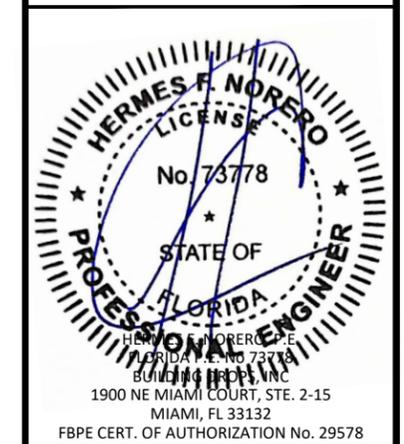

FL #: **FL22410**

DATE: **04.26.23**


DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **EWS031**

SHEET: **3** OF 7


s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwg\122410\ews031.dwg
 12/8/2023 9:03 AM

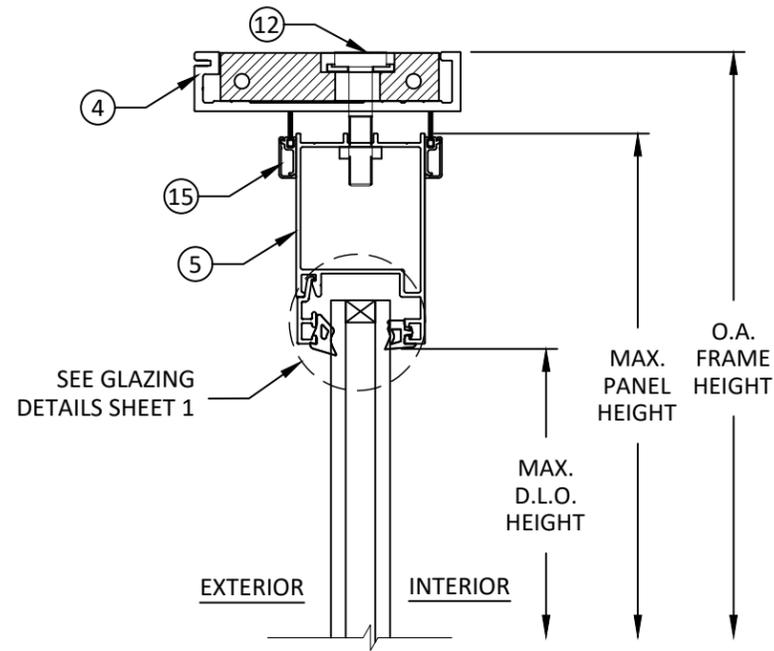


A
4 **VERTICAL SECTION**
OUTSWING DOOR

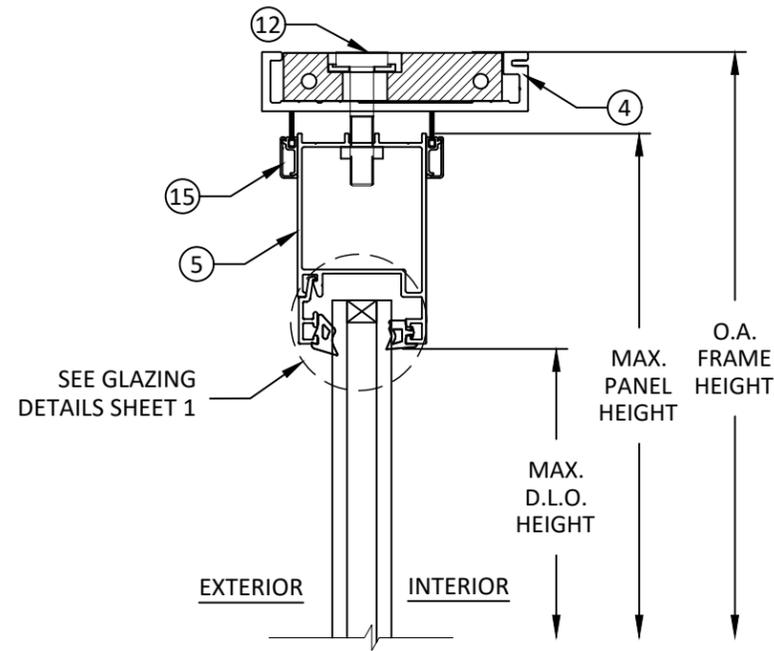

B
4 **VERTICAL SECTION**
INSWING DOOR

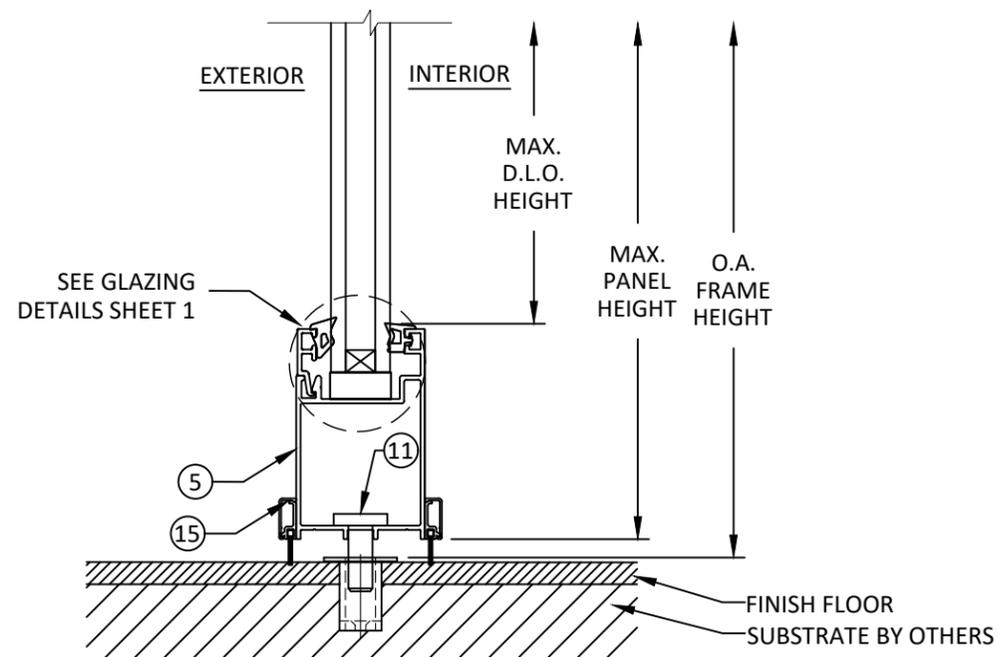

C
4 **VERTICAL SECTION**
TYPICAL FOR I/S OR O/S
WITHOUT DRAINAGE

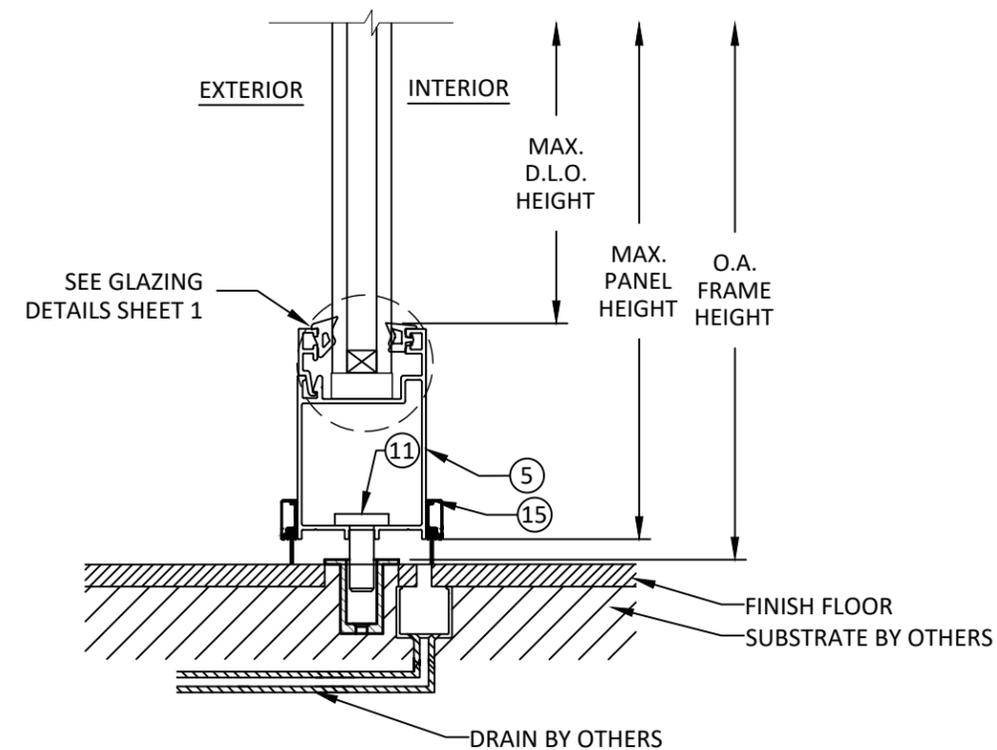

D
4 **VERTICAL SECTION**
TYPICAL FOR I/S OR O/S
WITH DRAINAGE

euro-wall
SUPERIOR BY DESIGN

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876

TITLE: EURO-PIVOT INSWING
AND OUTSWING DOOR
(NON-HVHZ)(NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

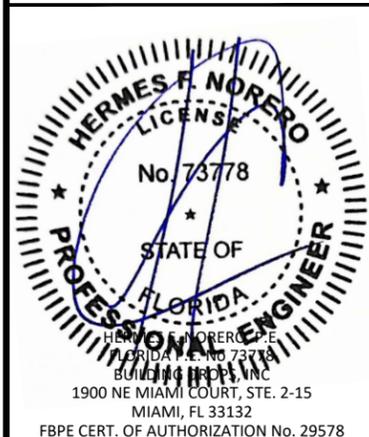

FL #: **FL22410**

DATE: **04.26.23**


DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **EWS031**

SHEET: **4**


s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design pressure table updates\dwg\122410\ews031.dwg

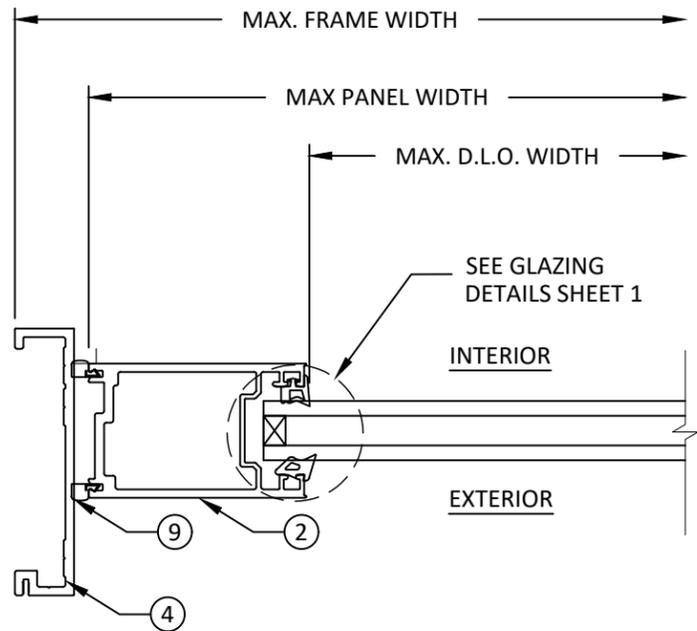


A HORIZONTAL SECTION
5 OUTSWING DOOR

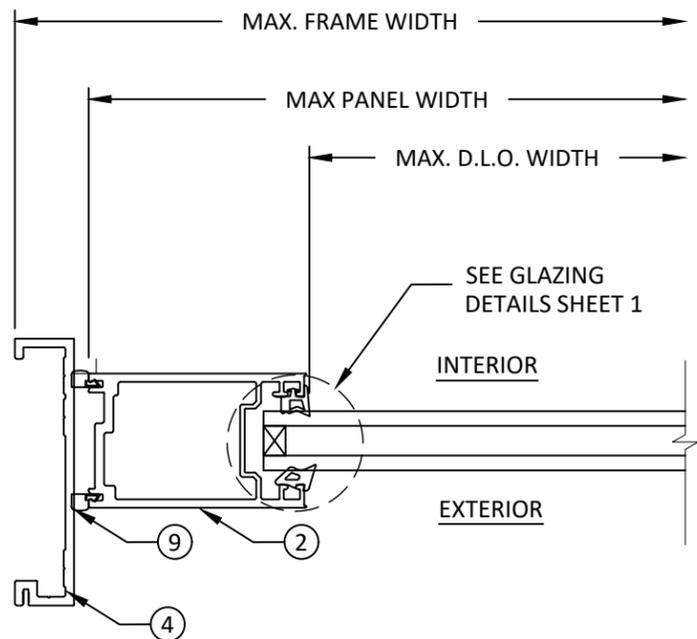

C HORIZONTAL SECTION
5 INSWING DOOR

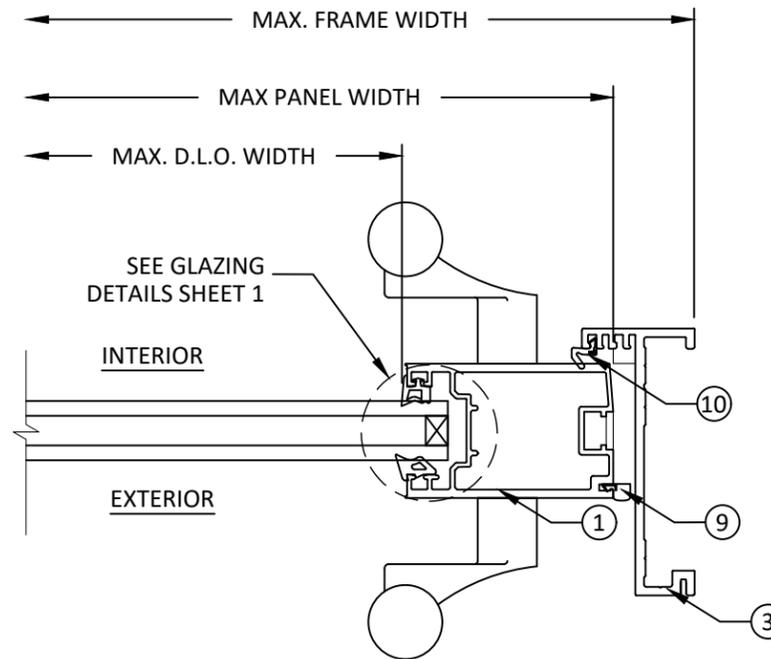

B HORIZONTAL SECTION
5 OUTSWING DOOR

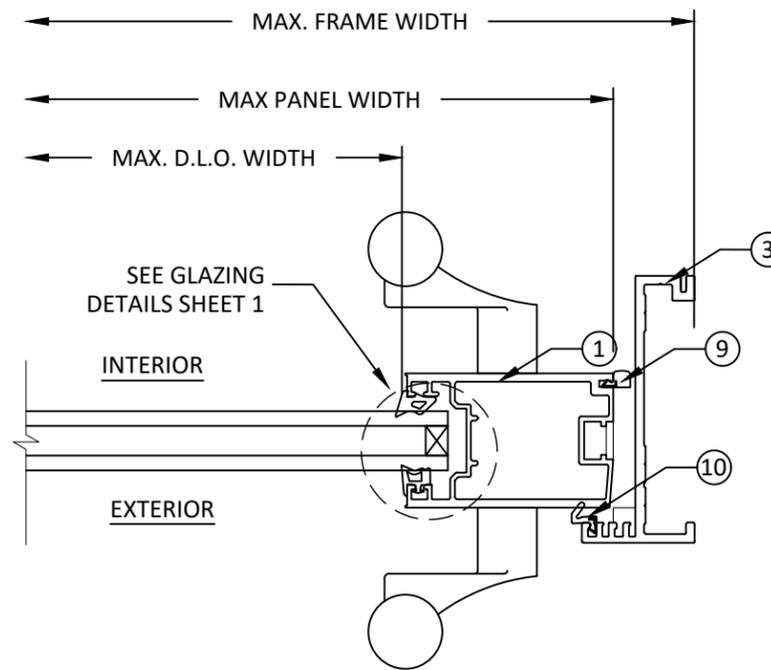


D HORIZONTAL SECTION
5 INSWING DOOR

TITLE: EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)(NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

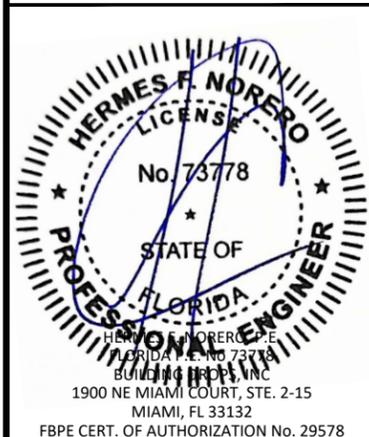

FL #: **FL22410**

DATE: **04.26.23**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **EWS031**

SHEET:

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS SPECIFIED IN THE ANCHOR SCHEDULE. TWO (2) INSTALLATION ANCHORS AT THE JAMBS.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, 1X WOOD BUCK MAY BE USED (OPTIONAL AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE.) SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME (HEAD/JAMBS)	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. F _y = 33KSI	#12 SELF DRILLING OR SELF TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"
	METAL: ALUMINUM MIN. 1/8" THICKNESS. MIN. 6063-T5			
	CONCRETE: f' _c =3000PSI	1/4" ITW TAPCON	1.75"	3.00"
	MASONRY: CMU per ASTM C90	1/4" ITW TAPCON	1.75"	4.00"

TITLE: EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)/(NON-IMPACT)

INSTALLATION NOTES, ANCHOR TABLE, & ANCHOR DETAILS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

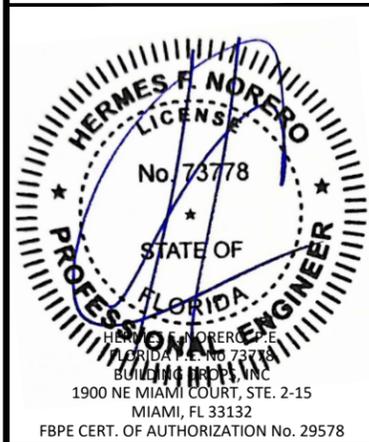


FL #:	FL22410
DATE:	04.26.23
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	EWS031
SHEET:	6

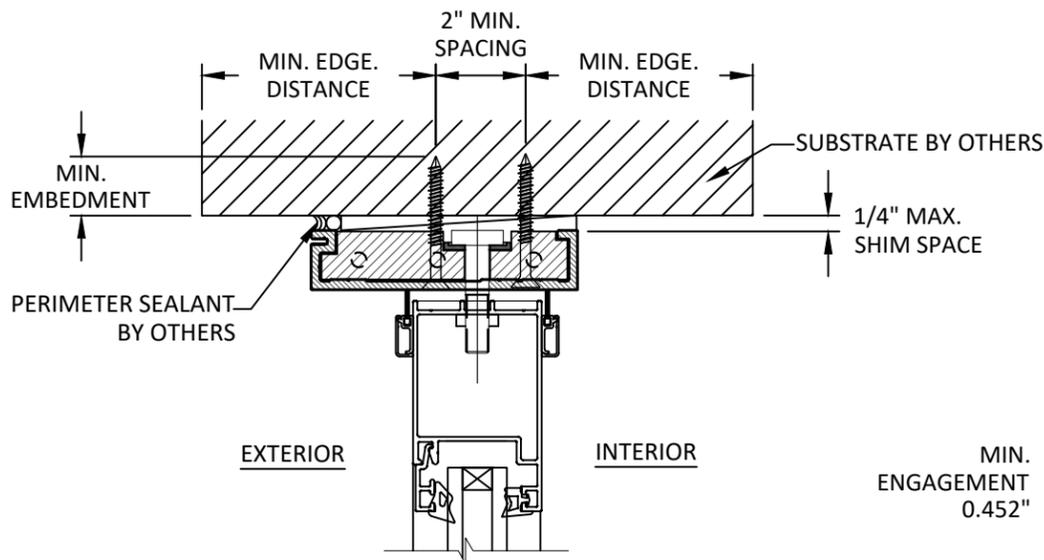


A
6 ANCHOR DETAIL THROUGH FRAME (HEAD)

OUTSWING DETAILS SHOWN, INSWING SIMILAR

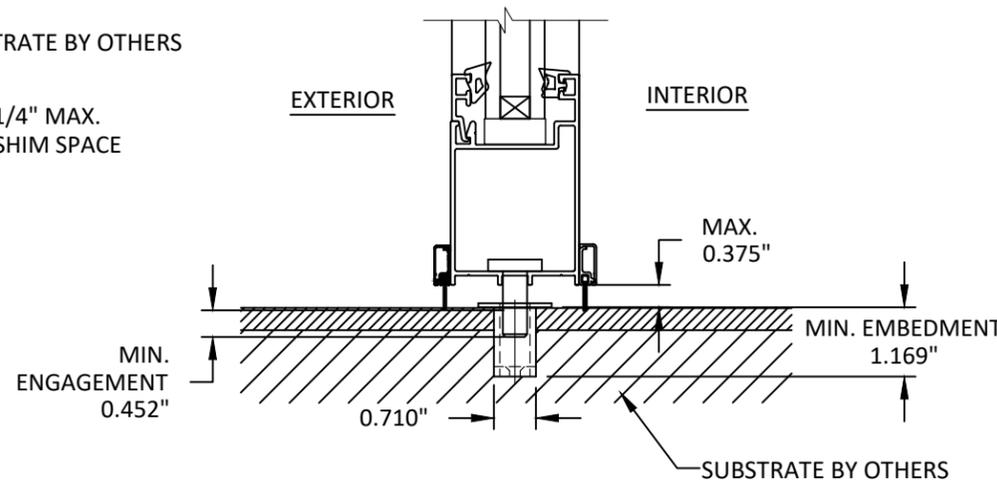










B
6 ANCHOR DETAIL PIVOT (SILL)

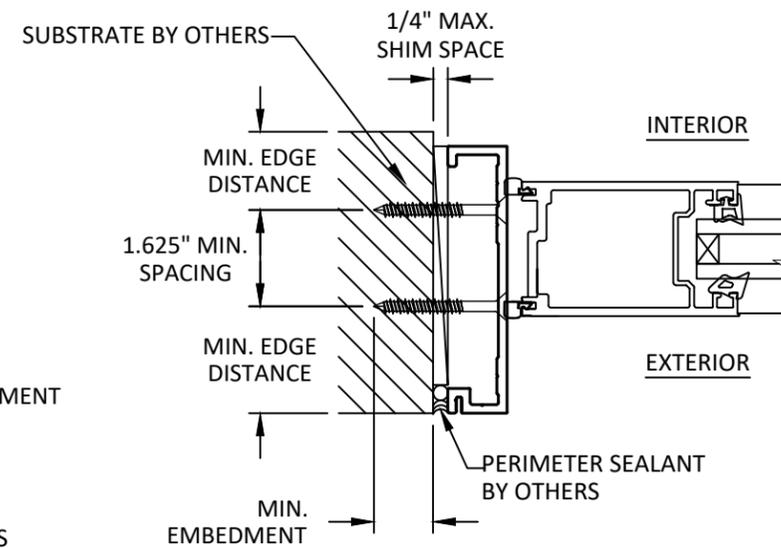

C
6 ANCHOR DETAIL THROUGH FRAME (JAMB)

s:\projects\euro-wall systems\fbc-23-1121 - fbc submittal - non-impact aluminum products design table updates\dwg\122410\ews031.dwg

BILL OF MATERIALS			
NO	PART #	DESCRIPTION	MATERIAL
1	E0027-A C3	ACTIVE STILE	6063-T5
2	E0036-A C3	RECESSED STILE	6063-T5
3	E0033-A C3	LOCK JAMB	6063-T5
4	E0045-A PV	HINGE JAMB/HEAD	6063-T5
5	E0035-A C3	RAIL	6063-T5
6	E0010-A C3	BEAD	6063-T5
7	C0057-A	GLAZING-PIVOT 7/8"	6063-T5
8	C0058-A	BEDDING-PIVOT	6063-T5
9	C0112-A	BIG P WEATHER STRIPPING-PANEL	URETHANE
10	C0114-A	FRAME WEATHER STRIPPING	URETHANE
11	C0038-A	PIVOT DOOR PIN BOTTOM	STAINLESS STEEL
12	C0039-A	PIVOT DOOR PIN TOP	STAINLESS STEEL
13	C0062-A	TWIN POINT HANDLE SHORT	STEEL ASSY
14	C0064-A	MULTIPOINT HANDLE	STEEL ASSY
15	C0053-A	DOOR SWEEP	NYLON
16	E0062-A	C3 REDUCER BAR .25in	6063-T5
17	E0063-A	C3 REDUCER BAR 9/16	6063-T5
18	THUMB TURN	THUMB TURN	STEEL
19	E0031-A	CORNER KEY	6063-T5
20	PULL BAR	PULL BAR	ALLOY

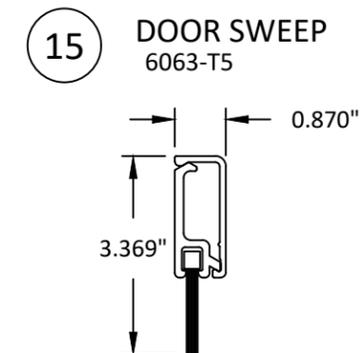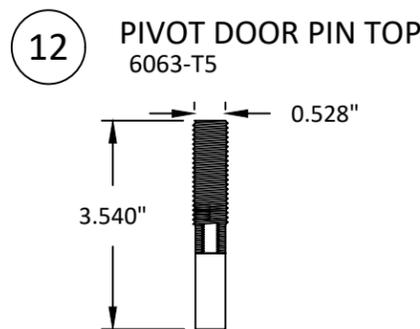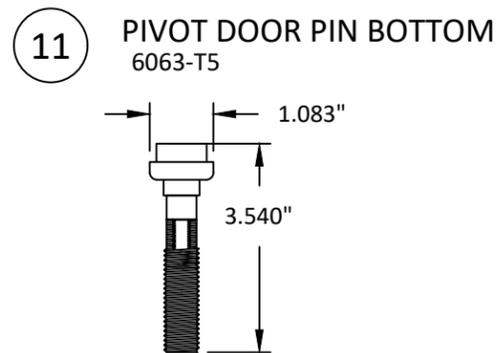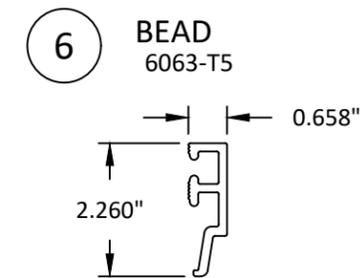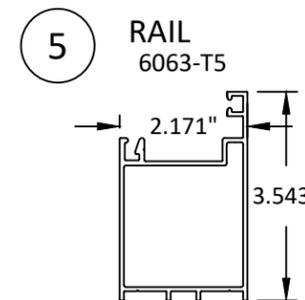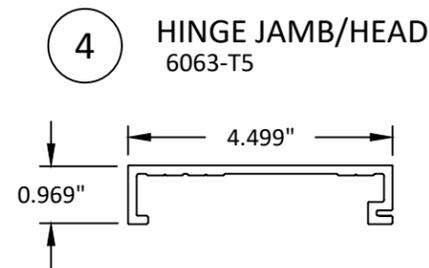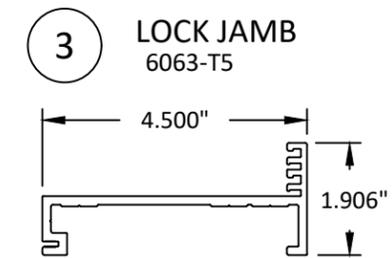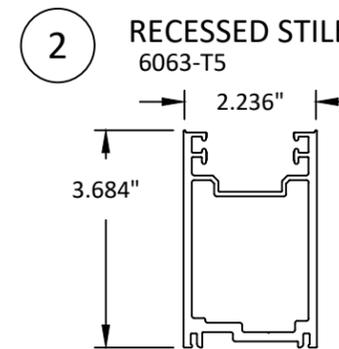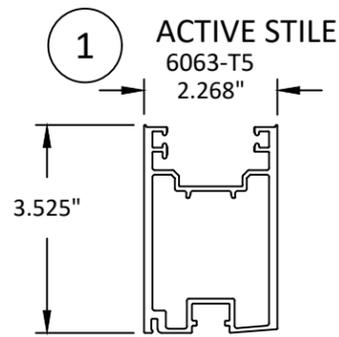

euro-wall
SUPERIOR BY DESIGN

EURO-WALL, LLC
P.O. BOX 8007
NORTH PORT, FL 34290
PH: 888-989-3876

TITLE: EURO-PIVOT INSWING AND OUTSWING DOOR (NON-HVHZ)/(NON-IMPACT) BILL OF MATERIALS & COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
COMPANY NAME UPD.	SH	09/23
DP TABLE UPDATES	SH	12/23

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

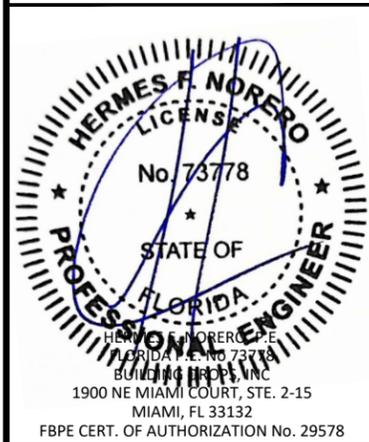

FL #: **FL22410**

DATE: **04.26.23**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **EWS031**

SHEET:

7

OF 7